

Installation Instructions


1. These products are intended for use as a 4-20 mA / Rs485 data line surge protector on data circuits.

2. Wiring the Stabil Data Line Surge Protector Module


2.1 Connect the corresponding incoming data line to the connectors labeled "LINE" on the appropriate protection modules (on screw terminal cable interface).

2.2 Connect the out going data lines to the connectors labeled "EQUIP."

The definition of each port is as follows :

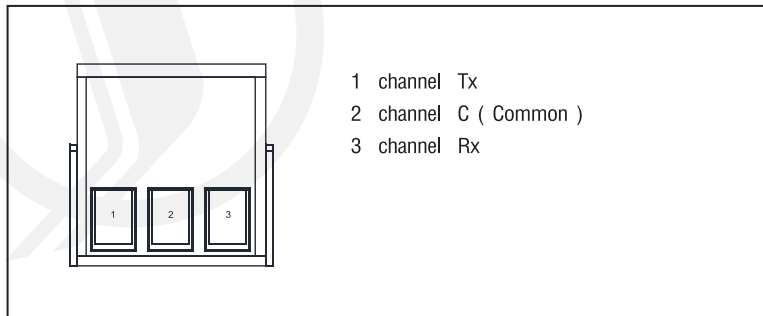

Detail of Data Line Surge Protector

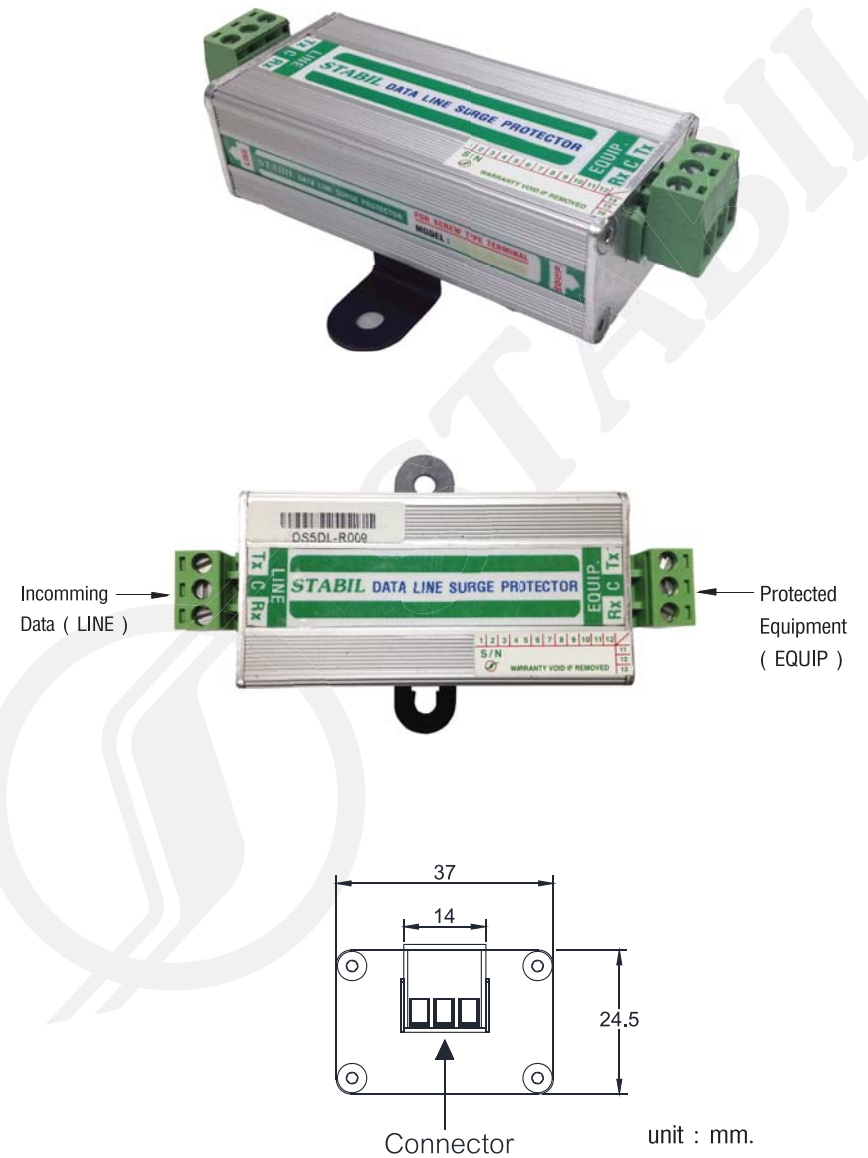

Installation Instructions

STABIL DATA LINE SURGE PROTECTOR

Model : TCDL-420-E9



Applications :

- 4-20 mA / Rs485 Interface



77 STABIL Building, Trok-Nok-Khet, Nonsee Road, Chongnonsee, Yannawa, Bkk 10120
 ☎ 0-2681-5533 Fax : 0-2681-7533 ✉ info@stabil.co.th 🌐 StabilSavedFromLightning
 🌐 WWW.STABIL.CO.TH 🌐 WWW.STABILTH.COM 020861

Thank you for purchasing the STABIL Data Line Surge Protectors

For questions or comment, please contact us at
 Tel : 0-2681-5533 or visit our website www.stabil.co.th

WARNING

1. IMPORTANT SAFETY INSTRUCTIONS!

2. Use each model on specified data application only !
3. The protector will interrupt communications in the event of self sacrifice.